




GROUNDWATER QUALITY ANALYSIS REPORT

Kandal - Kandal Stueng - Kandaok (N/A)



Kandaok is located in the district of Kandal Stueng. The population of this commune is approximately 4474 (2004). Groundwater sample collection occurred in September 2006 and consisted of the sampling of 3 tube wells throughout the commune. The attached figure presents the location of Kandaok within Kandal as well as groundwater sample locations and exceedances of health-impacting contaminants (when applicable).

Groundwater Quality Rating

An insufficient number of samples were collected in this commune to adequately characterize groundwater conditions. A groundwater quality rating is not presented for this commune.



Contaminants of Potential Concern – Health

No health-impacting contaminants of concern were observed within this commune.

Contaminants of Potential Concern – Aesthetic

Iron - Elevated concentrations of Iron were observed within the commune. At elevated concentrations, Iron causes water to be cloudy and unpleasant to drink. An odor may also be encountered at high concentrations. Iron can also stain laundry, food (can cause discoloration of cooked rice), and leave deposits. Aeration allows oxygen to enter the water and react with Iron to form a compound which is insoluble in water. The newly formed solids will slowly settle to the bottom or can be removed more rapidly by filtration. Performing these procedures may reduce the concentration of Iron in water but follow-up testing is recommended to ensure water quality standards are met.

Turbidity - Elevated levels of Turbidity were observed within the commune. Turbid or cloudy water appears unpleasant to the eye and is more likely have an unpleasant taste or odor. Turbidity can be reduced by filtration.

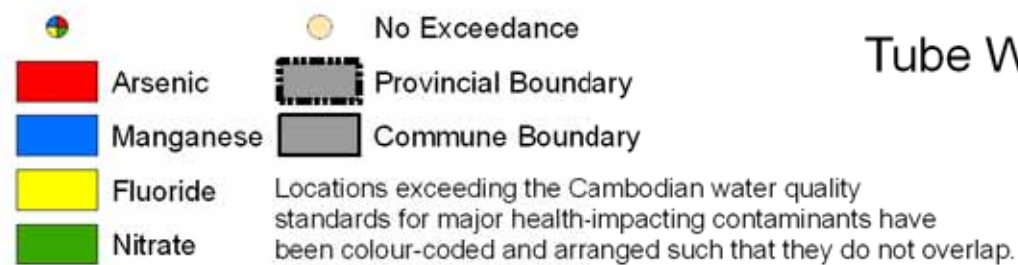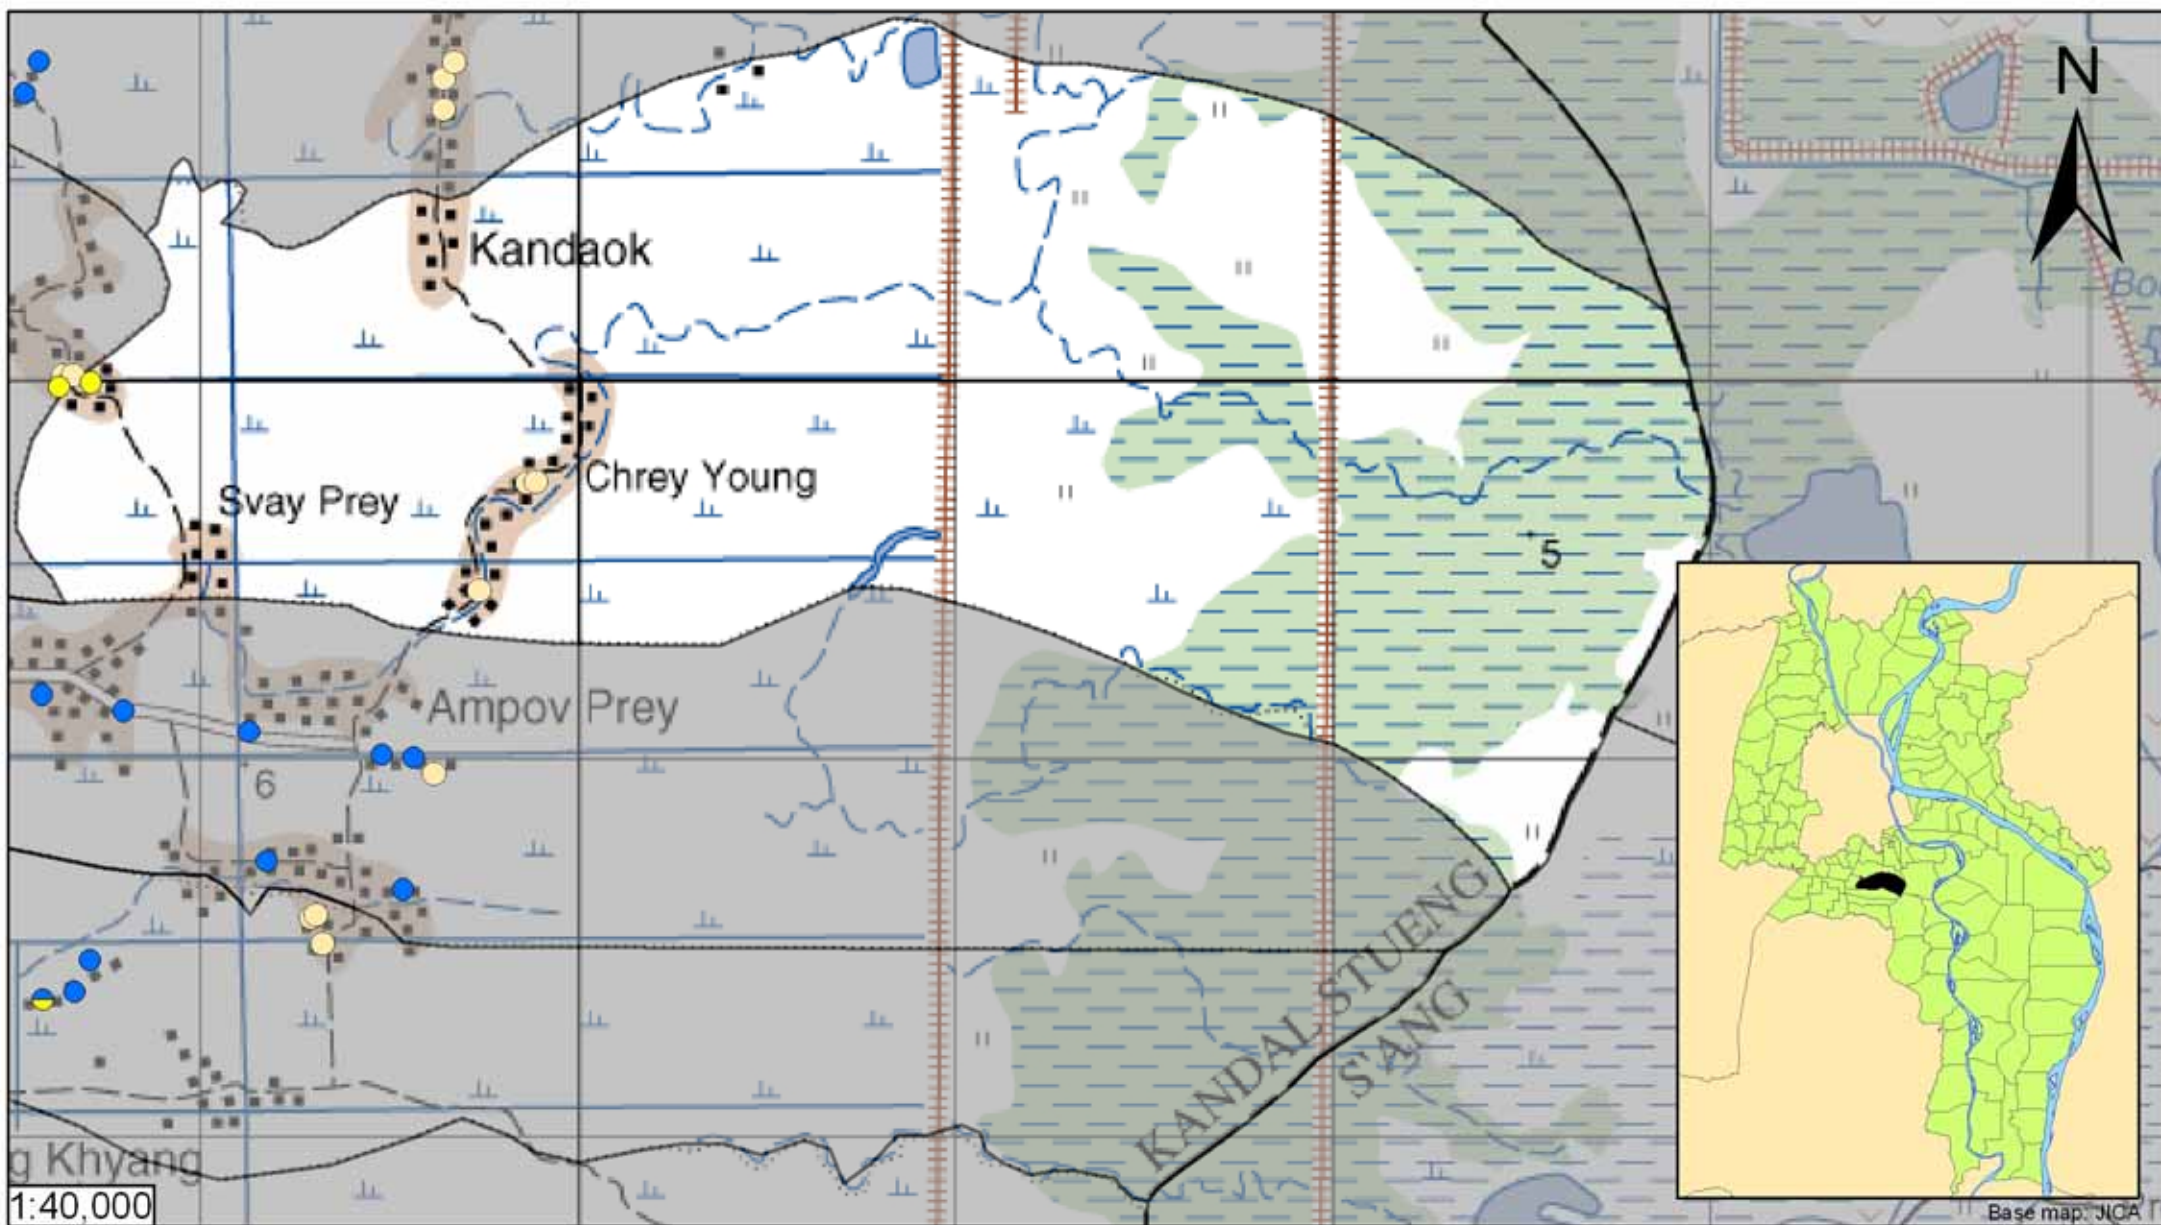

Tube Well Sample Locations and Health-Based Exceedances

Kandaok- Kandal Stueng - Kandal - Cambodia

Resource Development International - Cambodia

www.rdic.org

June 2008

